




PPL Electric Utilities

REMSI Sketches 26-50
Sketch #50
6-51


0000-000-ST-6051
 Custom ID: DCS 6-51
 Revision: 01
 Effective Date: 09/19/2016
 Page 52 of 52

Sketch #50 Underground 3 phase, 4 wire, 480/277 volt, service entrance arrangements

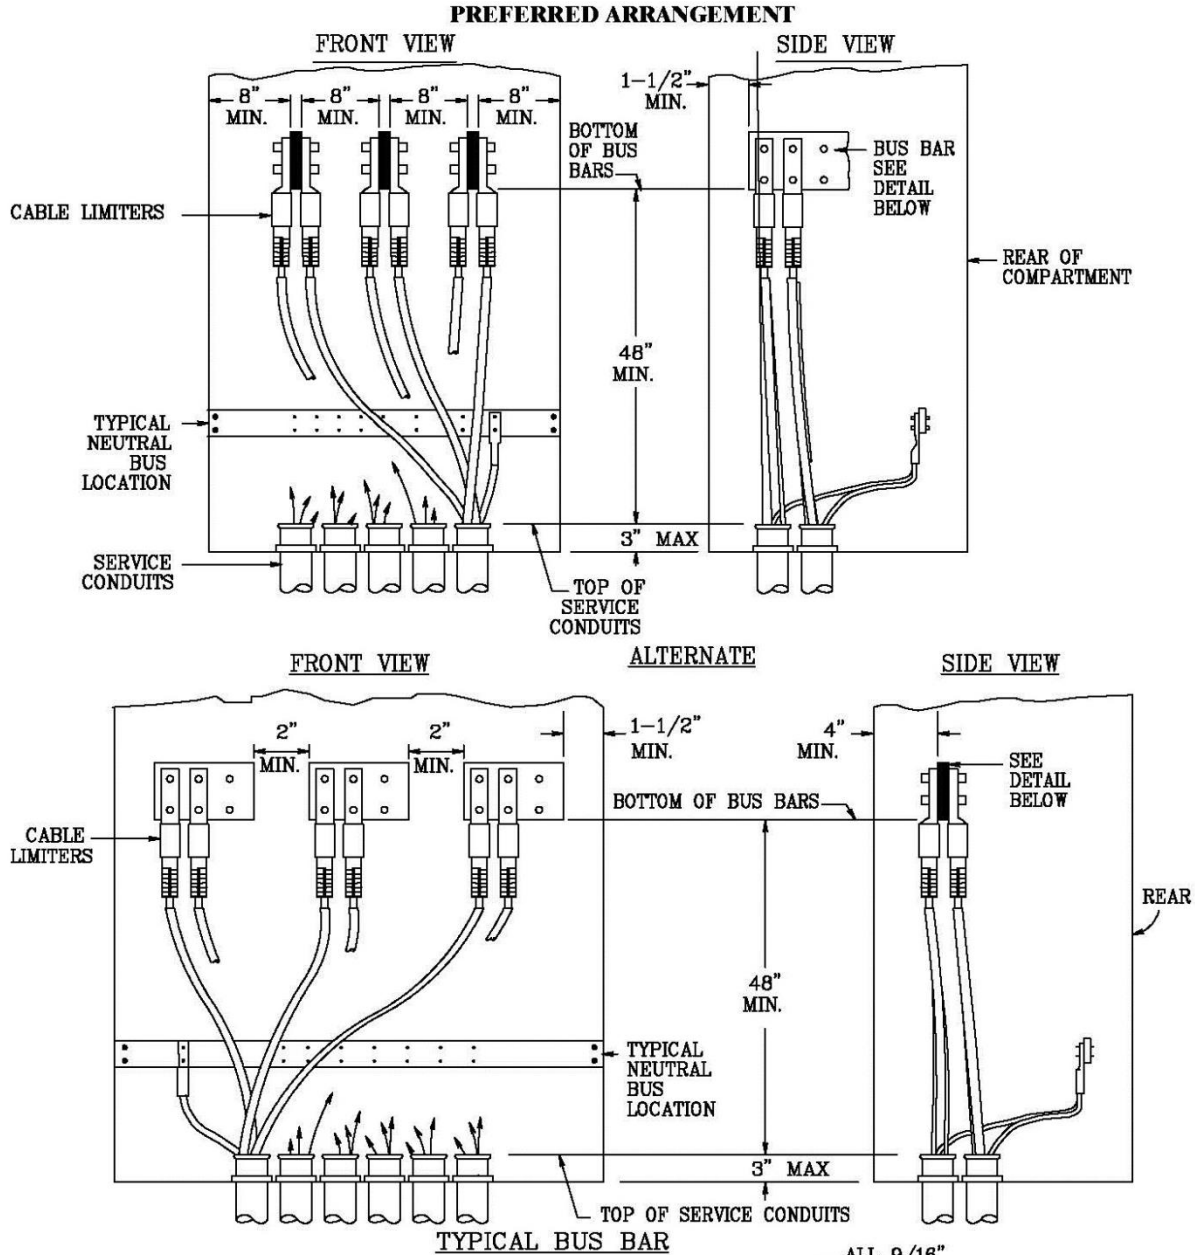

NOTE:

BUS BARS MUST BE DRILLED AS SHOWN TO ACCOMMODATE CABLE LIMITERS.

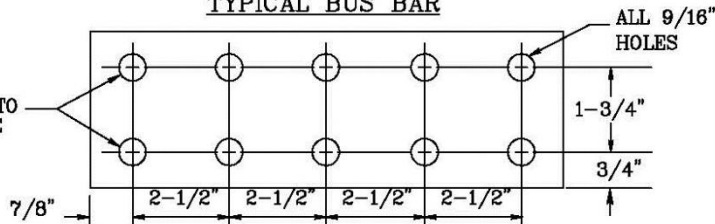

*REFERENCE CRS 6-19-100

REMSI_S050.dwg

RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS
PPL ELECTRIC UTILITIES CORPORATION

Rules: 15

Date: 7/18/16 **Engr:** NAP